
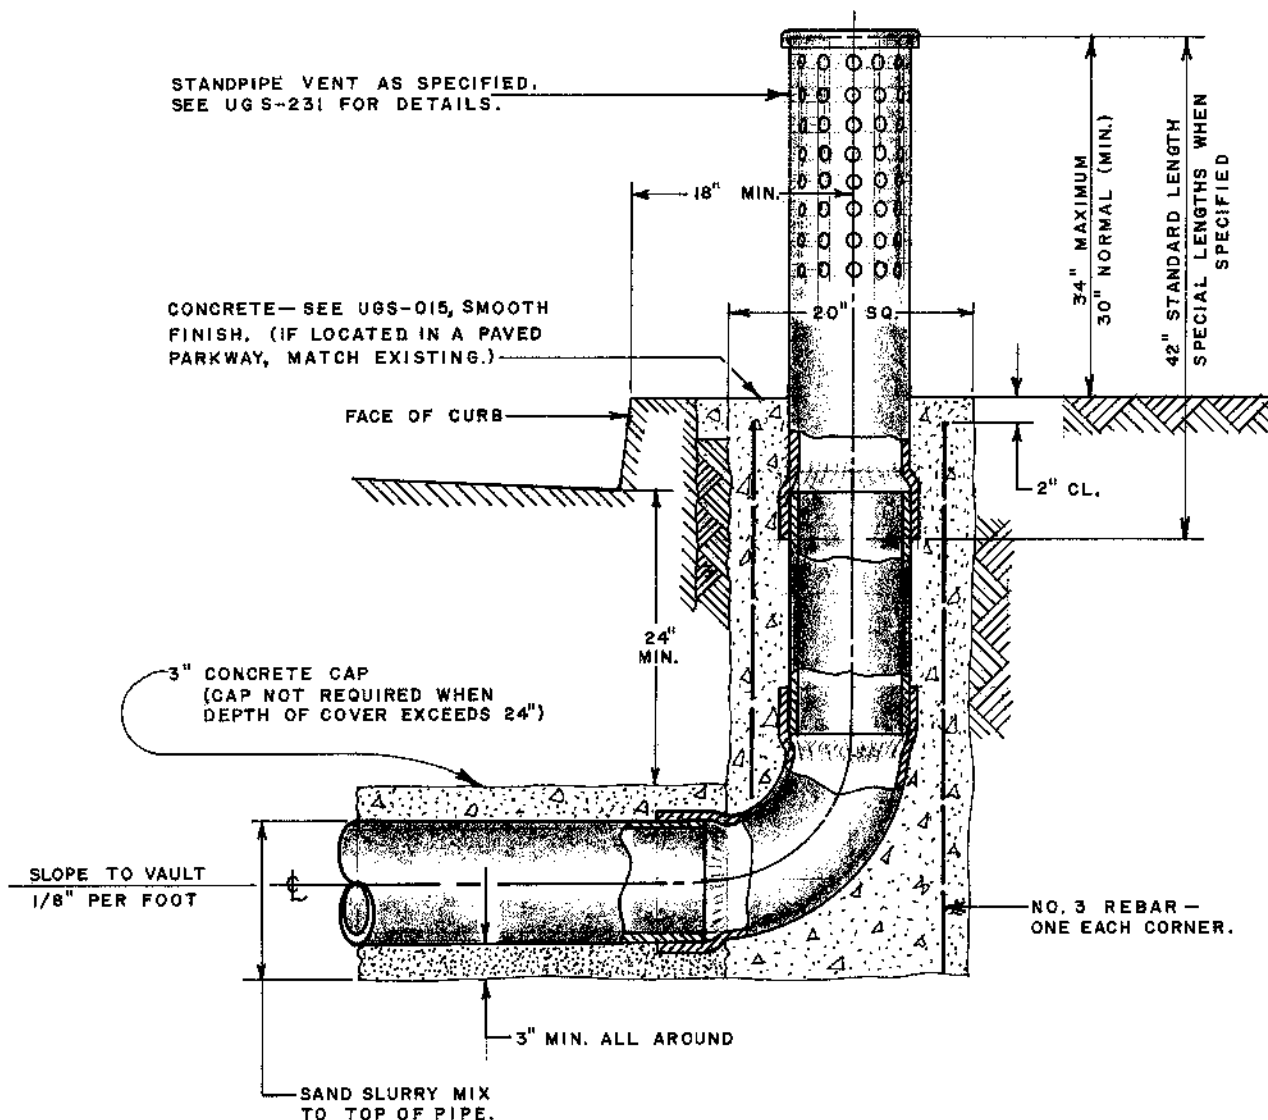


STANDPIPE VENT INSTALLATION

1/1/76

NOTES:

1. VENTS SHALL BE 10" DIA. UNLESS SPECIFIED OTHERWISE ON THE WORKING DRAWINGS. ALL JOINTS SHALL BE WATERTIGHT AND CONSTRUCTED TO THE RECOMMENDATIONS OF THE MANUFACTURER OF THE MATERIAL USED. AIR DUCT SHALL BE ONE OF THE FOLLOWING MATERIALS
 - A. ABS PLASTIC .200" MIN. WALL.
 - B. VITRIFIED CLAY PIPE; STD. STRENGTH.
 - C. TRANSITE AIR DUCT, TYPE 5.
2. WHERE CURBS & GRADES ARE NOT ESTABLISHED, BOTTOM HOLES OF VENTS MUST BE 10" MIN. ABOVE SURFACE OF THE GROUND.

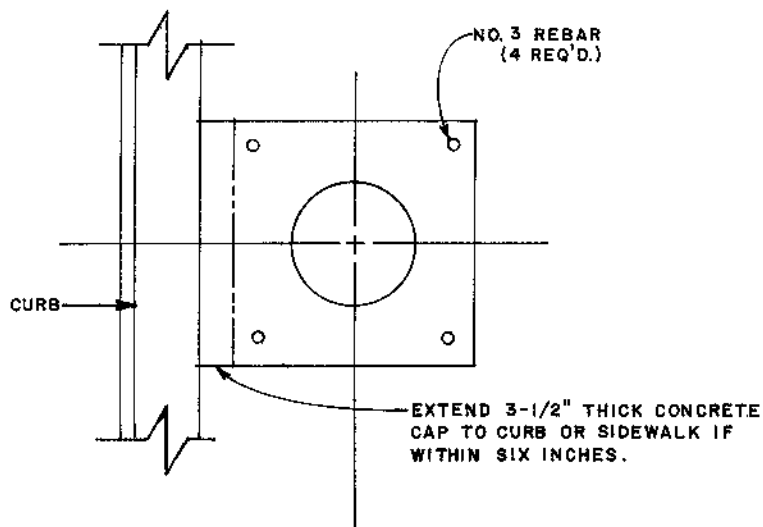

RIVERSIDE PUBLIC UTILITIES DEPT. - UNDERGROUND STRUCTURES

James D. Campbell
CHIEF UTILITY ENGINEER

LATEST REVISION: REDRAWN

UGS-233